


Wasserversorgungsgenossenschaft Hadlikon

**Schutzzone Neubrunnen Plan 1:2000  
(GWR f1255+f1256)**

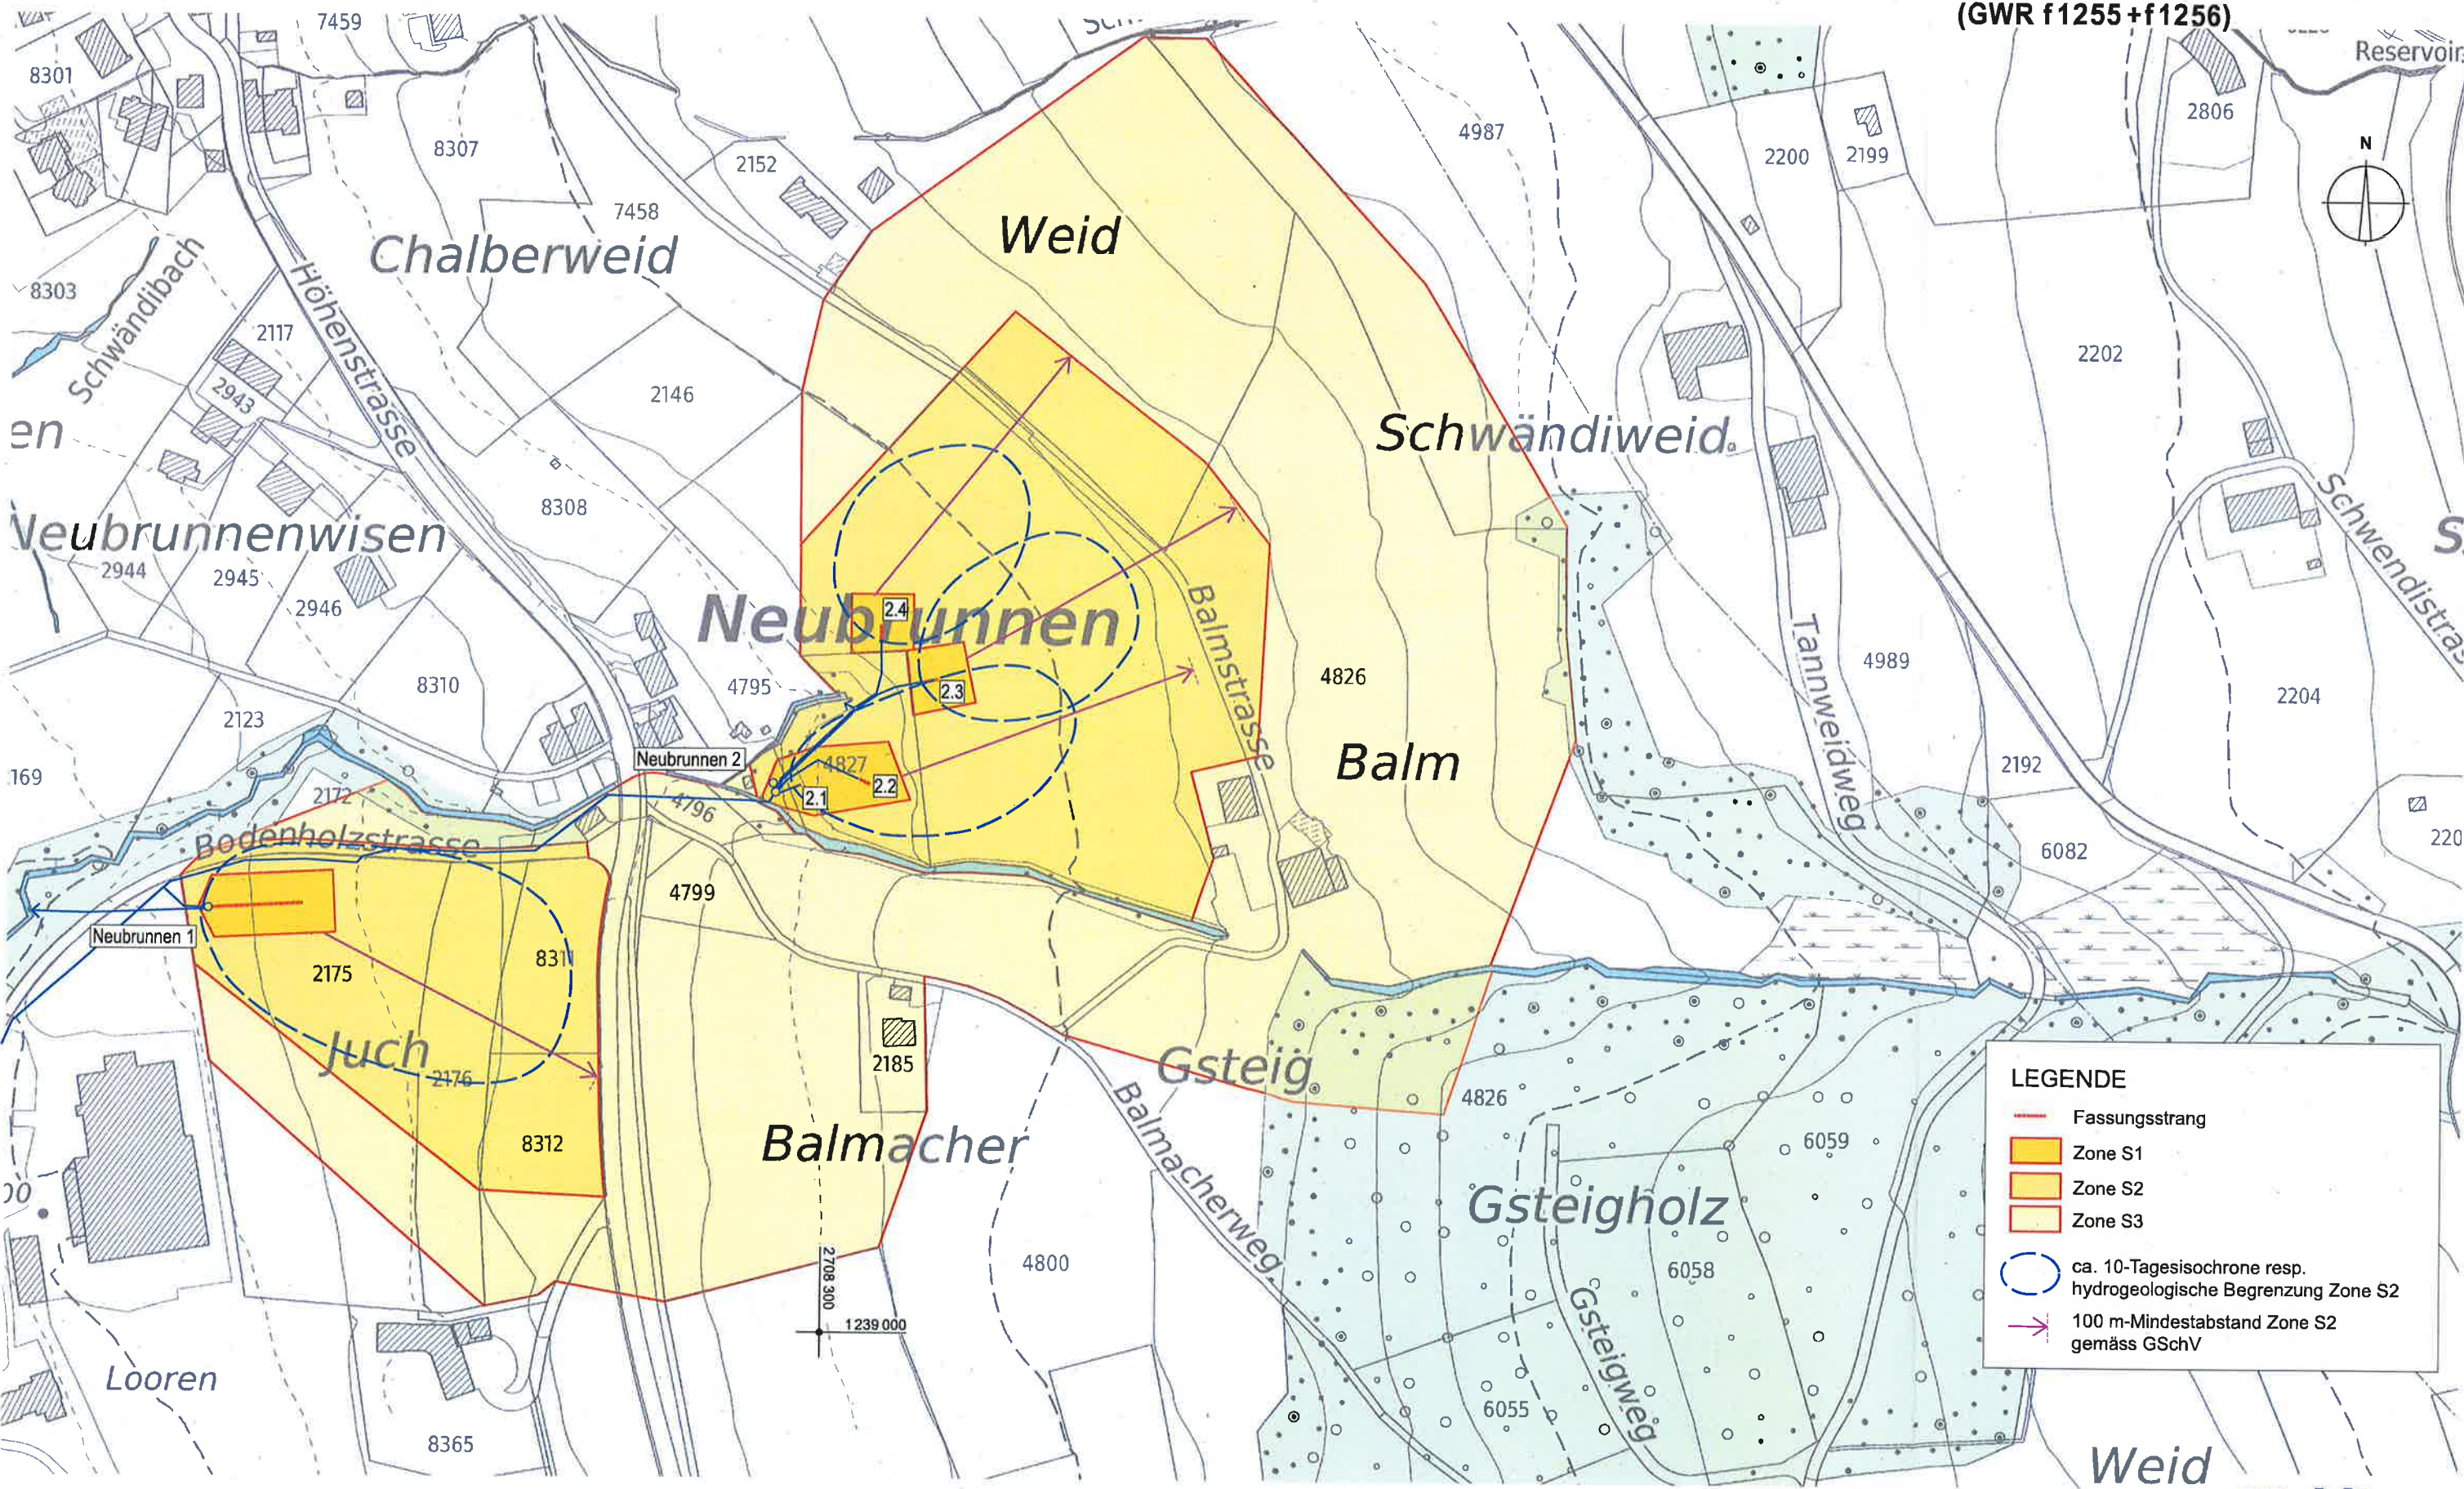

**LEGENDE**

- Fassungsstrang
- Zone S1
- Zone S2
- Zone S3
- ca. 10-Tagesisochrone resp. hydrogeologische Begrenzung Zone S2
- 100 m-Mindestabstand Zone S2 gemäss GSchV

